



SGS Canada Inc.

P.O. Box 4300 - 185 Concession St.
Lakefield - Ontario - K0L 2H0
Phone: 705-652-2000 FAX: 705-652-6365

Works #: 500038780

Project : PO#126993

19-August-2020

PVNC Catholic DSB (Reg243 - Notre Dame ES)

Attn : Donna Sorrell

Date Rec. : 11 August 2020

LR Report: CA16434-AUG20

1355 Lansdowne Street West
Peterborough, ON
K9J 7M3, Canada

Copy: #1

Phone: 705-748-4861 ext.286, Cell:905-396-7912
Fax:

CERTIFICATE OF ANALYSIS

Final Report

Sample ID	Sample Date & Time	Temperature Upon Receipt °C	Lead ug/L
1: Analysis Start Date		---	19-Aug-20
2: Analysis Start Time		---	08:59
3: Analysis Completed Date		--	19-Aug-20
4: Analysis Completed Time		--	11:32
5: MAC		--	10
6: MDL		---	0.01
7: TAP Standing - 133-FT-003	05-Aug-20 06:50	28.0	15.2 MAC RVNS
8: TAP Flushed - 133-FT-003	05-Aug-20 07:25	28.0	4.97 RVNS
9: TAP Standing - 133-FT-001	05-Aug-20 06:55	28.0	5.16 RVNS
10: TAP Flushed - 133-FT-001	05-Aug-20 07:30	28.0	3.07 RVNS
11: TAP Standing - 133-BF-003	05-Aug-20 07:05	28.0	7.72
12: TAP Flushed - 133-BF-003	05-Aug-20 07:40	28.0	0.98

MAC - Maximum Acceptable Concentration

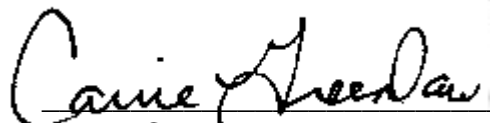
MDL - SGS Method Detection Limit

RVNS - Required Volume Not Submitted for Lead under 0.Reg243/07.

MAC - (ADVERSE) Above Maximum Acceptable Concentration

Method Descriptions

Units	Description	SGS Method Code
ug/L	Lead by ICP-MS Drinking Water	ME-CA-[ENV]SPE-LAK-AN-006


 Carrie Greenlaw
 Project Specialist,
 Environment, Health & Safety